




**SUPERSTITION FIRE & MEDICAL DISTRICT**

**FIRE LANE SIGN DETAIL**



BACK-OF-CURB TO BACK-OF-CURB, WIDTH (FT.)	PARKING CONDITION	SIGNS REQUIRED
Less than or Equal to <b>26'</b>	No Parking	Both Sides
From <b>26'-1"</b> to <b>32'-0"</b>	Parking on One Side	One Side
Equal to or Greater than <b>32'-1"</b>	Parking on Both Sides	Not Required

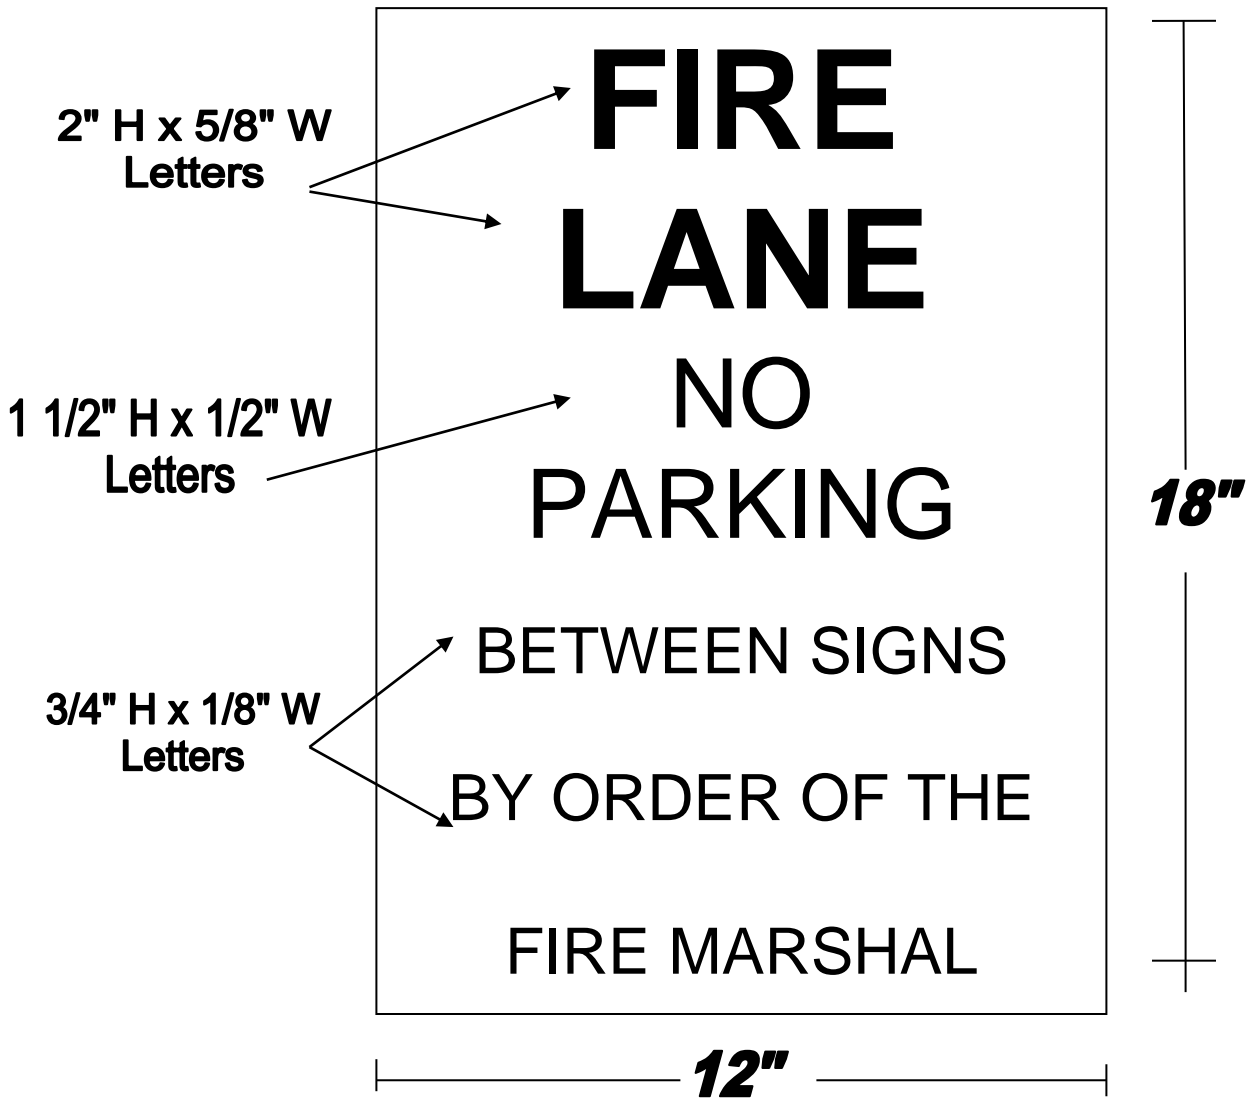

- ALL LETTERS ARE RED WITH A WHITE REFLECTIVE BACKGROUND.
- THE SIGN(S) ARE TO BE MOUNTED PER APPROVED MANNER.
- THE BOTTOM OF THE SIGN IS TO BE 7' ABOVE GRADE AND NO MORE THAN 75' APART.
- CURBING SHALL BE PAINTED BRILLIANT RED.
- THESE SIGNS ARE NOT SUPPLIED BY SUPERSTITION FIRE & MEDICAL DISTRICT