




Superstition Fire & Medical District




PRIVATE STREETS, INTERIOR STREETS & FIRE ACCESS LANE CONSTRUCTION DETAIL


All Fire Lanes Must be a Minimum of 20' Wide Unobstructed!

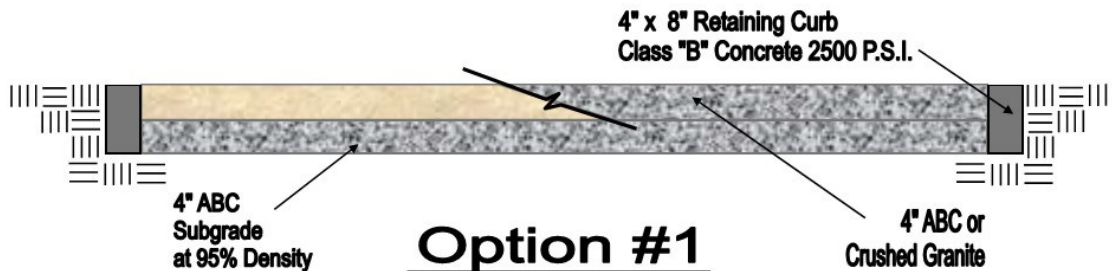

NOTE: Decomposed granite may be substituted for ABC on the top lift if desired for appearance. The top lift may be overlaid with up to 2" of topsoil for ground cover vegetation if so desired.

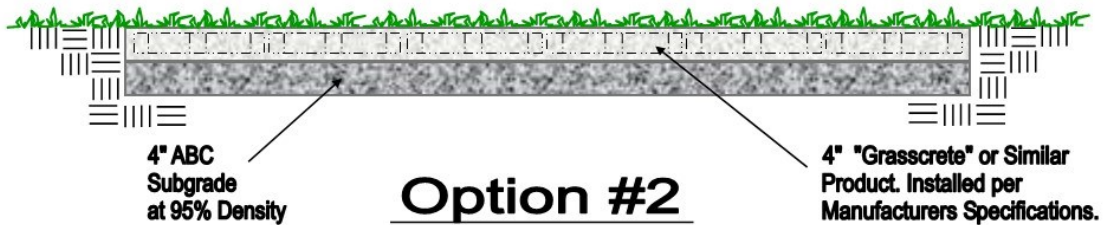

NOTE: Concrete block **MAY NOT** be substituted for "Grasscrete" or similar product.

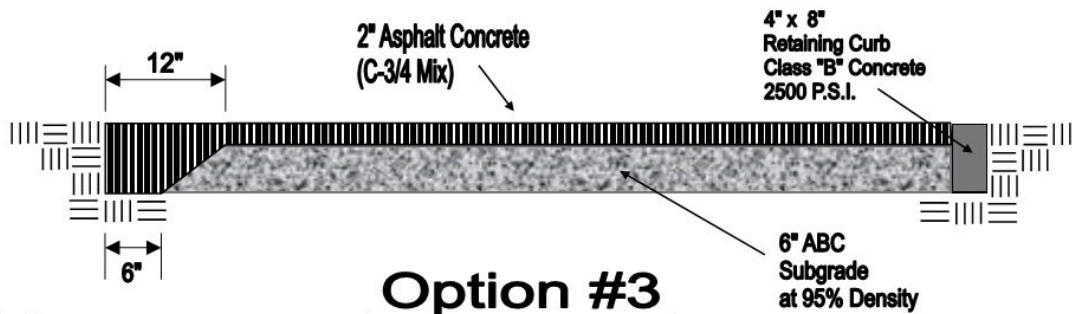

N.T.S.!