







LPG Aboveground Tank Installation Requirements



Tank supports must be of sturdy metal material and tanks must be secured to support by chains or other solid attachments. Supports must be a minimum of 1/2 the height of the tank(s) being supported.

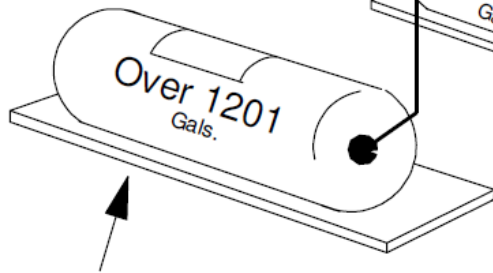

Slabs must be a minimum of 3" thick, and 6" wider than tank size in every direction.

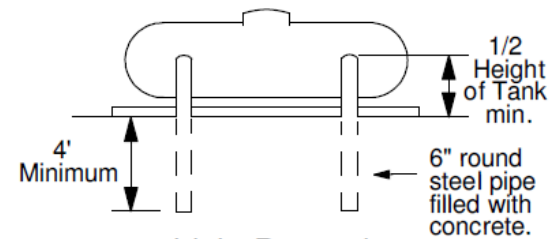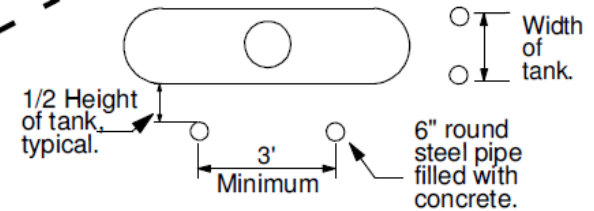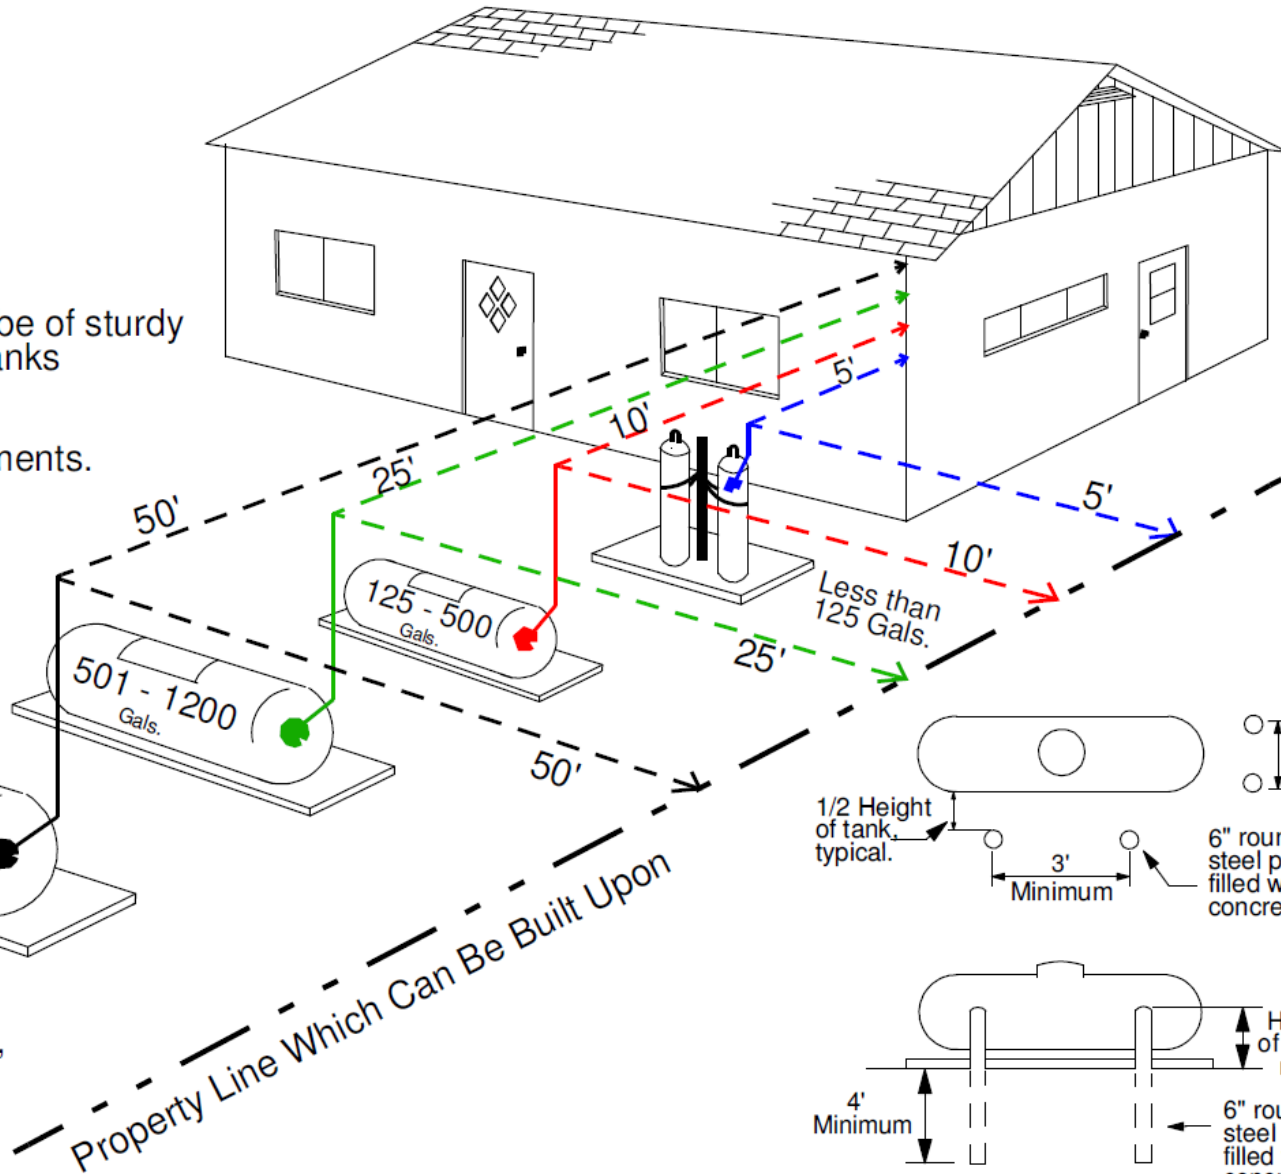

Vehicle Protection